

Thank you for choosing a NIVELCO instrument.
We are sure that you will be satisfied throughout its use!

NIVOSWITCH

SERIES R-400, R-400 EX
VIBRATING FORK LEVEL SWITCHES

1. APPLICATION

A NIVOSWITCH R-400 type vibration forks are applicable for level switching or flow switching tasks of normal and explosive liquids. Overfill or dry run protection as well as pump control is also possible with the NIVOSWITCH vibration forks in low/high fail-safe operation mode.

2. TECHNICAL DATA

2.1 GENERAL DATA

R-400 / R-400 Ex	
Medium pressure	40 bar, PP flange: 6 bar see „Temperature diagrams“
Probe length	0.69 m... 3 m
Material of wetted parts	DIN 1.4571, PFA coating
Medium temperature	see table in 5.1 and diagrams
Ambient temperature	see table in 5.1 and diagrams
Liquid density	$\geq 0.7 \text{ kg/dm}^3$
Liquid viscosity	$\leq 10000 \text{ mm}^2/\text{s}$ (cSt)
Response time	When immersed: 0.5 sec
	When free: $\leq 1 \text{ s}$ see response time diagram
Output mode indication	Bi-colour (LED)
Operation test	Output can be changed by test magnet

2.2 TWO-WIRE DC, NORMAL AND EX APPROVED VERSION

TYPE	2-wire DC	
	R 00-4 00-6 R 00-4 00-8 Ex	R 00-4 00-7 R 00-4 00-9 Ex
Electric connections	Connector	3 m cable (2 x 0.5 mm ²)
Ingress Protection	IP 65	IP 68
Output	DC current change: When free: $9 \pm 1 \text{ mA}$; When immersed: $14 \pm 1 \text{ mA}$	
Consumption	$< 0.5 \text{ W}$	
Power supply (U)	15 ... 29 V DC Provided by the PKK-312-8 Ex remote switching unit for the Ex version	
Setting operation mode	By switch on the remote switching unit (Low fail-safe, High fail-safe)	
Electrical protection	Class III.	
Ex protection mark of RC_4_ _ _ Ex and RG_4_ _ _ Ex	II 1G Ex ia IIC T4...T6 Ga	
Ex protection mark of RA_4_ _ _ Ex	II 1G Ex ia IIB T4...T6 Ga	
Intrinsically safe data	U < 29 V, I < 100 mA P<1.4 W, C _{eq} < 7 nF L _{eq} ≈ 0 For temperature classes see 5.1.	

User's manual



NIVELCO



Manufacturer
NIVELCO Process Control Co.
H-1043 Budapest, Dugonics u. 11.
Phone: (36-1) 889-0100 ■ Fax: (36-1) 889-0200
E-mail: sales@nivelco.com ■ www.nivelco.com

2.3 2-WIRE AC AND 3-WIRE DC VERSIONS

TYPE	2-WIRE AC		3-WIRE DC	
	R 00-4 00-1	R 00-4 00-2	R 00-4 00-3	R 00-4 00-4
Electric connections (wire cross section)	Connector	Integral cable (4 x 0.75 mm ²) max length 30 m	Connector	Integral cable (5 x 0.5 mm ²) max length 30 m
Mechanical protection	IP 65	IP 68	IP 65	IP 68
High/low mode setting	Connection within connector	Wire selectable	Switch selectable	Wire selectable
Output	2-wire AC, for serial connection		Field selectable, PNP/NPN transistor switch	Field selectable, galvanically isolated PNP/NPN transistor switch
Output protection	—		Reverse polarity, overcurrent and short-circuit protection	
Supply voltage	20 ... 255 V AC, 50/60 Hz		12 ... 55 V DC	
Consumption	Depending on load		$< 0.6 \text{ W}$	
Voltage drop in switched-on state	$< 10.5 \text{ V}$		$< 4.5 \text{ V}$	
Electrical protection	Class I		Class III	
Current load	max. continuous	350 mA AC 13	I _{max} = 350 mA DC / U _{max} = 55 V DC	
	min. continuous	10 mA / 255 V, 25 mA / 24 V	—	
	max. impulse	1.5 A / 40 ms	—	
Residual current (in switched off state)	$< 6 \text{ mA}$		$< 100 \mu\text{A}$	

2.4 ACCESSORIES

- User's manual
- Declaration of conformity
- Warranty Card
- RPS-101 type test magnetic-screwdriver (optional)
- 1 pc Sealing ring (2 mm thick KLINGER OILIT)
- Sliding sleeve for adjustable types: RPH-112 (optional)


2.5 ORDER CODES

TYPE		CODE		CODE		CODE	
Tube + plastic (PFA) coated fork	A	BSP 1"	M	Short (69 mm)	00	2-wire AC+ connector	1
Tube + 1.4571 fork	C	BSP 1 1/2"	H	Standard (125 mm)	01	2-wire AC+ cable	2
Tube + highly polished fork	G	NPT 1"	P	0.2 ... 3 m	02 ... 30	3-wire DC+ connector	3
		NPT 1 1/2"	N			3-wire DC+ cable	4
		DN50 PN16 PP DIN	F			2-wire DC+ connector	6
		DN50 PN40 1.4571 DIN	G			2-wire DC+ cable	7
		ANSI 2" RF150 PP	A			2-wire DC+ connector + Ex	8
		ANSI 2" RF600 1.4571	B			2-wire DC+ cable + Ex	9
		JIS 10K 50A PP	J				
		JIS 40K 50A 1.4571	K				
		Triclamp 1 1/2"	T				
		Triclamp 2"	R				
		DN40 Pipe coupling	D				
		DN50 Pipe coupling	E				


* Ex version with Ex mark.

Note: Flanged versions have 1" process connection.


2.6 TEMPERATURE DIAGRAMS

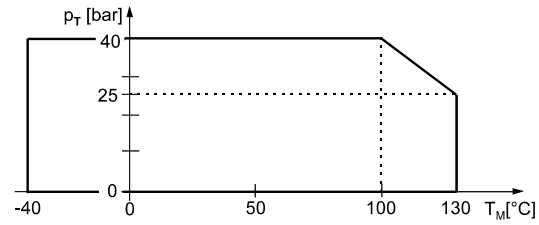


Pressure [p_T] as a function of temperature [T_M] for all versions (except PP flanged version)

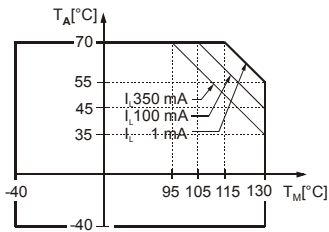

Temperature limits of DC versions, [I_L] load current

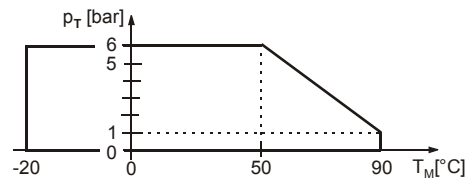


Pressure [p_T] as a function of temperature [T_M] for PP flanged version


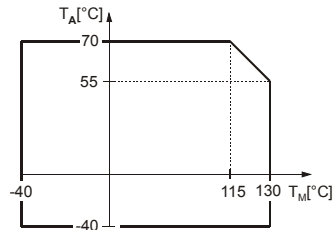


Temperature limits of AC versions, [T_A] ambient temperature [T_M] medium temperature


2.7 RESPONSE TIME DIAGRAM (WHEN GETTING FREE)

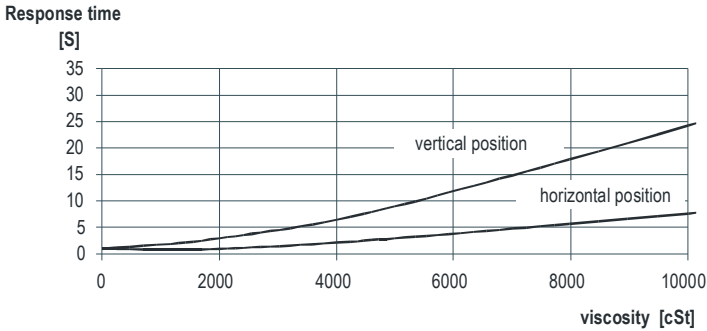

2.8 DIMENSIONS

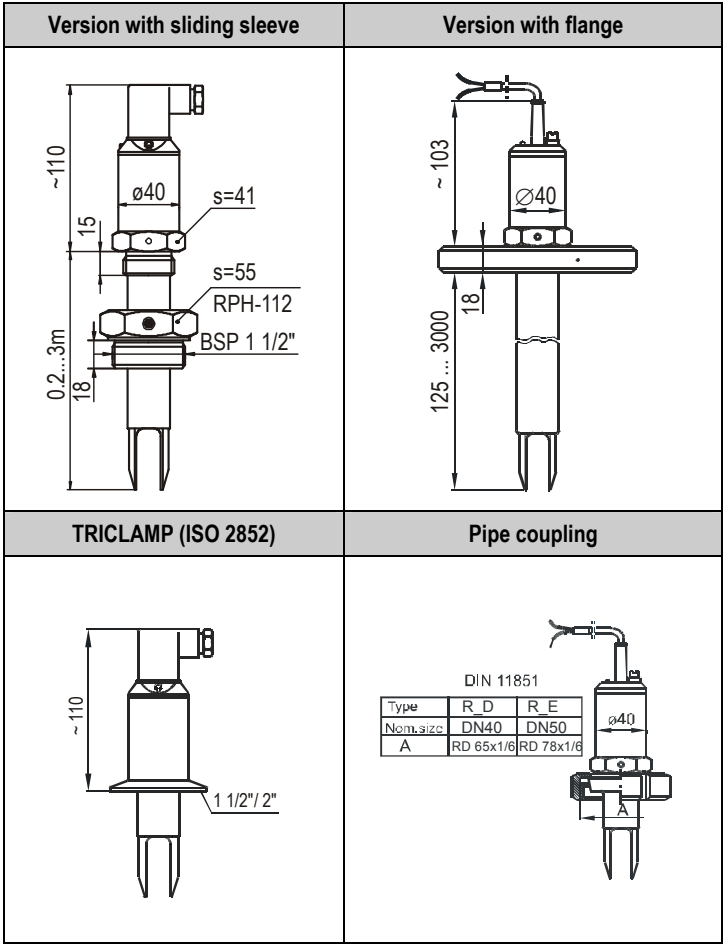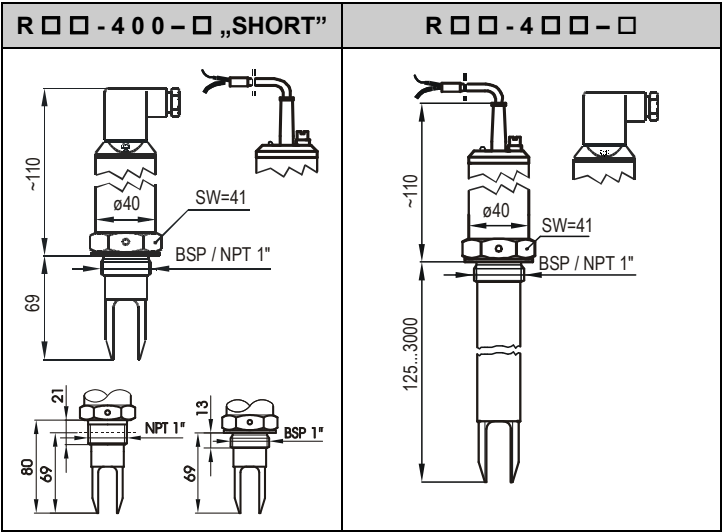


2.9 MATERIALS

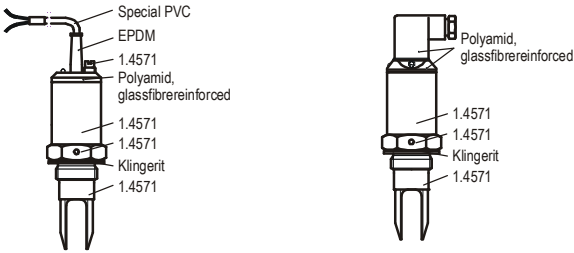


3. INSTALLATION

Prevent the device from any mechanical damage.

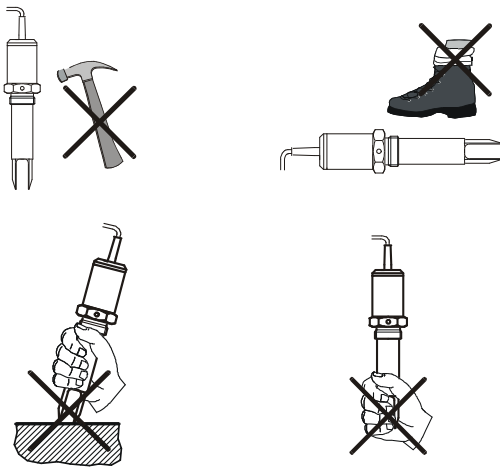

For positioning the fork-tines, use the marking on the hexagonal neck.




- If directional positioning of the fork-tines is needed (side mounting), use the TEFLON (PTFE) tape to seal the thread and position the fork-tines to the desired direction.
- In this case vertical positioning of the fork-tines is suggested.

Low viscosity liquids


On applications, where the fork-tines are easily freed from the process medium, any of the mountings shown to the right is possible.

High viscosity liquids


On applications, where the fork-tines are not freed easily from the process medium, the horizontal mounting is recommended.

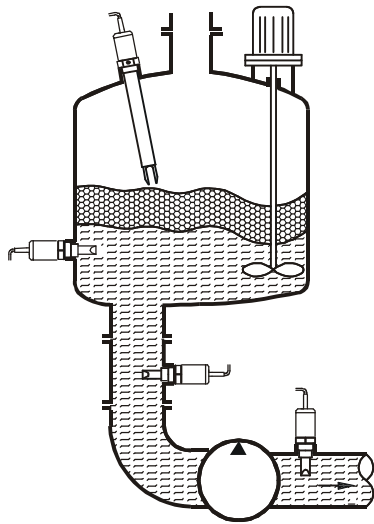


Installation options




Threaded version



Flanged version, critical distances: $x > 5 \text{ mm}$



For pipe mounting, fork-tines must be parallel to the direction of flow

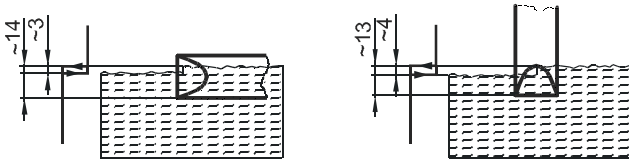

Switching point and differential for water at 25 °C

Switching point as well as the switching differential depends on liquid density and mounting position.

4. WIRING


4.1. 2 WIRE AC VERSIONS

R □ □ - 4 □ □ - 1 connector
R □ □ - 4 □ □ - 2 cable

DO NOT POWER UP THE DEVICE WITHOUT A LOAD CONNECTED IN SERIES WITH THE UNIT AND WITHOUT GROUNDING IT!

4.1.1. Version with connector

R □ □ - 4 □ □ - 1

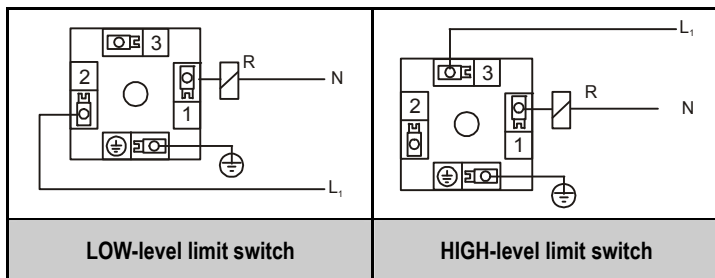


Terminal block cover can be rotated in 90° steps to ensure appropriate cable positioning.

4.1.2. Version with cable

R □ □ - 4 □ □ - 2

This version is with 4 wire cable equipped. Only one of the black and brown wires is used, dependent on the operating mode (High or Low).

Provide also a terminal block connection for the unused wire.

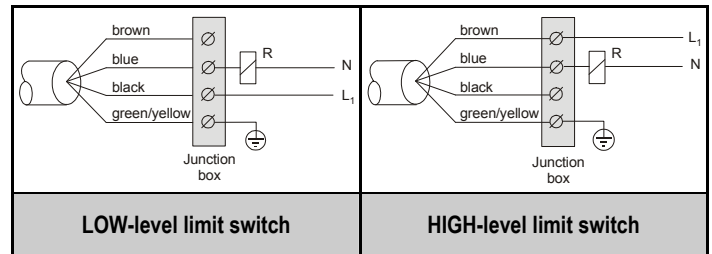

4.2. 3 WIRE DC VERSIONS

R □ □ - 4 □ □ - 3

R □ □ - 4 □ □ - 4

In case of overload caused by short circuit, transistor will switch on and off, and LED will start to blink.


4.2.1. Version with connector

R □ □ - 4 □ □ - 3


"M" - Operation mode

H= High - level limit switch

L= Low - level limit switch




4.2.1.1. Wiring of 3-wire DC version with connector in case of relay application

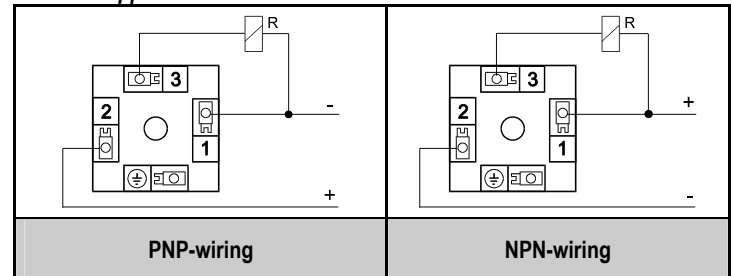

Terminal block cover can be rotated in 90° steps to ensure appropriate cable positioning.

4.2.1.2. Wiring of 3-wire DC version with connector in case of PLC application

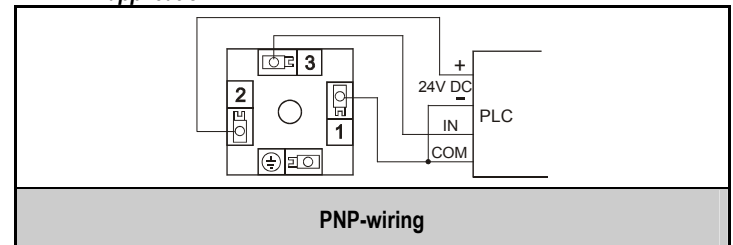


4.2.2. Version with cable


R □ □ - 4 □ □ - 4

4.2.2.1. Wiring in case of relay applications


PNP-wiring

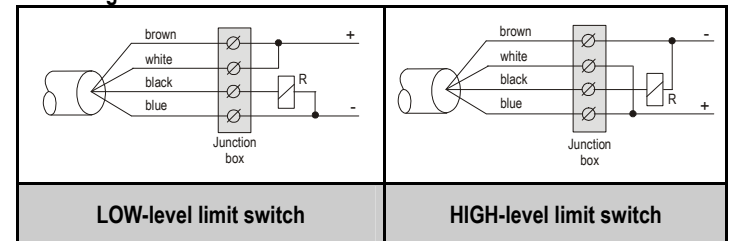

NPN-wiring

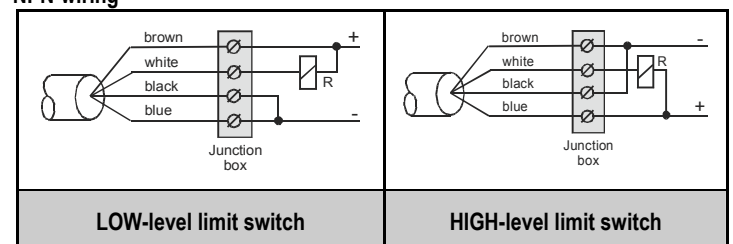


4.2.2.2. Wiring in case of PLC applications
PNP-wiring

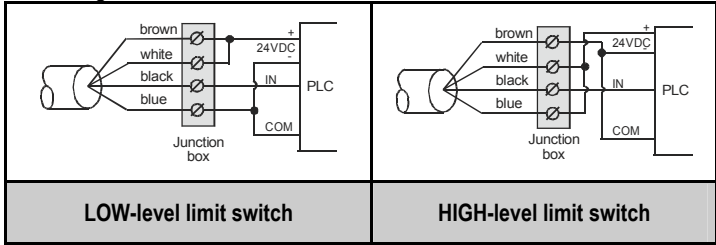


4.3. 2-WIRE DC VERSIONS, NORMAL OR EX

4.3.1. Version with connector

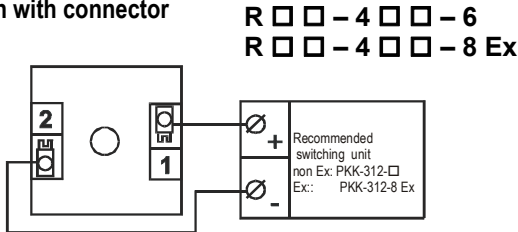

4.3.2. Version with cable

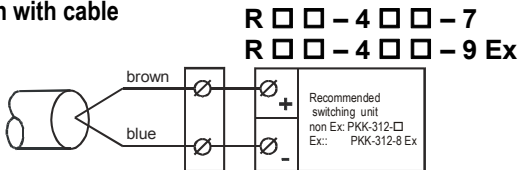

5. PUTTING INTO OPERATION, ADJUSTMENT

Check connecting of the wires and position of the mode of operation switch (if there is). After connection and power up the tuning fork is operational.
Operation diagram of the NIVOSWITCH:


POWER SUPPLY	FORK	MODE	DISPLAY (LED)	OUTPUT
ON	Immersed	HIGH	RED	OFF
		LOW	GREEN	ON
	Free	HIGH	GREEN	ON
		LOW	RED	OFF
NONE	Free or immersed	HIGH or LOW	NOT LIT	OFF

Operation diagram of the 2-wire DC version

FORK	DISPLAY (LED)	OUTPUT
Immersed	RED	14 ± 1 mA
Free	GREEN	9 ± 1 mA

OPERATION TEST

Correct operation of the switching circuit of an installed device can be tested with the optional test magnet (RPS-101). Moving the test magnet in front of the marking on the cover of the housing the device must perform a switching (LED changes colour).




5.1. APPLYING Ex APPROVED MODELS

Applying Ex approved models take into consideration the table of allowed temperatures listed below.

TEMPERATURE CLASSIFICATION	T6	T5	T4
T _{ambient}	70 °C	60 °C	60 °C
T _{medium}	70 °C	75 °C	130 °C

Table of possible temperatures

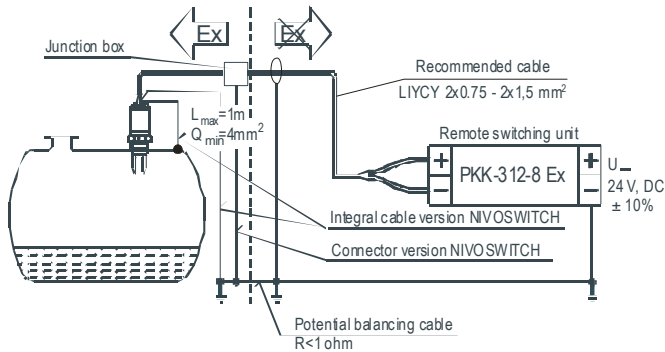

5.2 CONDITIONS OF SAFE OPERATION

ATEX II 1G Ex ia IIC T4...T6 Ga and II 1G Ex ia IIB T4...T6 Ga approved vibrating forks should be powered by intrinsically safe [Ex ia IIC or IIB] certified and approved devices.

Junction box shall be applied for **R □ □ - 4 □ □ - 9 Ex** versions with cable connection. Junction box shall meet the appropriate protection requirements.

The instrument has built-in overvoltage protection, so:


- Outer grounding of the electric housing shall be connected to the steel silo wall with a minimal 4mm² cross sectioned, shielded copper cable — outside the Zone 0 — within the distance of 1 m from the boundary of the Zone 0.
- According to point 6.3.12 of EN 60079-11 standard dielectric strength test is not allowed to perform with the instrument.

To avoid the danger of electrostatic charge accumulation, in case of the coated version **RA □ - 4 □ □ - □** type the following safety rule shall be observed:

- Measured medium shall be an electrostatic conductor, electrical resistivity of the medium shall be ≤ 10⁴ Ωm.
- Speed of the filling and emptying process shall be chosen properly according to the measured medium.

6. MAINTENANCE, REPAIR

In some instances, the sensor probe may need occasional cleaning to remove surface deposits. This must be carried out gently, without harming the vibrating section of the vibrating fork.



7. STORAGE CONDITIONS

Ambient temperature: -25 ... +60 °C
Relative humidity: max. 98 %

8. WARRANTY

NIVELCO provides warranty of 3 (three) years in compliance with details described in the Warranty Card.

rcm4004a0600h_07
2010. July

NIVELCO reserves the right to change technical specifications without notice.